

Source: Prestolite Electric Leece Neville Heavy Duty Systems


Bulletin No: TWB-0073 **Date:** April 20, 2022

Models: BLD BLP 4000 Series

Subject: Wiring Diagram Remote Regulator



techservice@prestolite.com

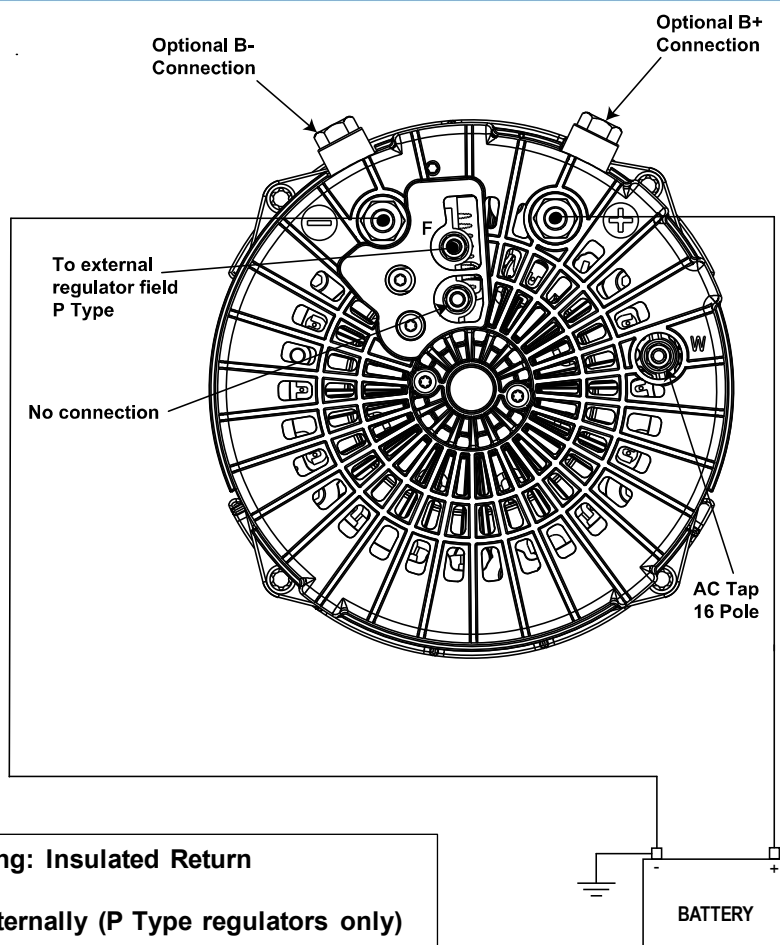

Alternator Grounding: Insulated Return

Field: Grounded internally (P Type regulators only)

Terminal tightening torque values

F	2.0 – 2.5 Nm
(B+) (B-)	9.0 – 13.50 Nm

Important: The information contained in this bulletin is intended for use by trained, professional technicians who have the proper tools, equipment, and training to perform the required maintenance described above. This information is NOT intended for 'do-it-yourselfers', and you should not assume that this information applies to your equipment. If you have any questions regarding this information please visit our website at www.prestolite.com, or contact our technical service department at:

Technical Service: techservice@prestolite.com

